



SIDEWALK EXPANSION JOINT AT BUILDINGS

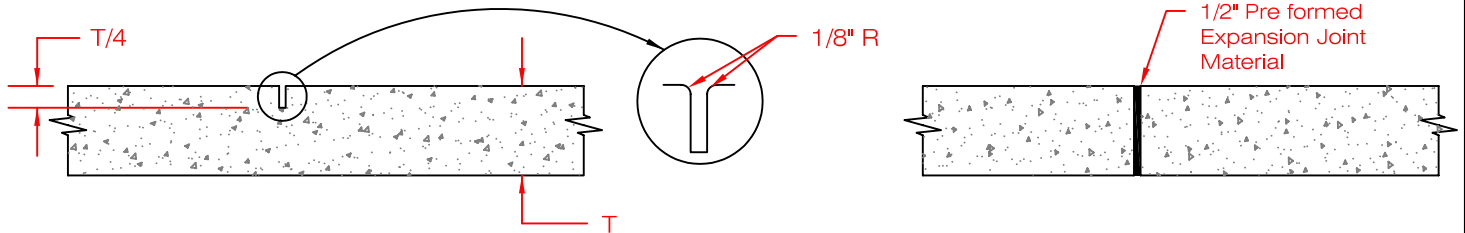

CURB & GUTTER/SIDEWALK TOOLED JOINT

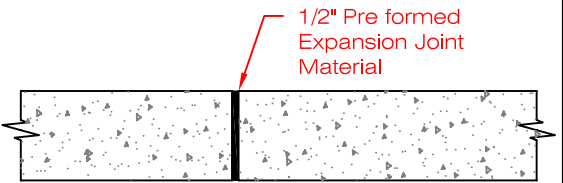

SIDEWALK EXPANSION JOINT

NOTES:

1. Concrete sidewalk tooled joint spacing:  
 10' - combination curb & gutter sidewalks  
 10' - curb & gutter, curbhead, or mountable curb  
 5' - detached sidewalk
2. For sidewalks, expansion joints shall be provided every 100-120 feet and shall extend for the depth and width of the concrete.
3. Expansion joint material shall be installed between new sidewalk and existing buildings (see detail).
4. Expansion joint material shall be installed between new sidewalk and existing concrete slabs, inlets, fire hydrants, poles, and other fixed objects.
5. Expansion joint material between curb and sidewalk is required when sidewalk abuts back curb on concrete streets.
6. These do not apply to bike paths- See Parks & Recreation Standards.

DATE: 5/05

CITY & COUNTY OF DENVER

PUBLIC WORKS

STD. DWG NO.

CURB & GUTTER AND SIDEWALK



5.4