


This Half Details Standard Driveway with Detached Walk

This Half Details Standard Driveway with Attached Walk

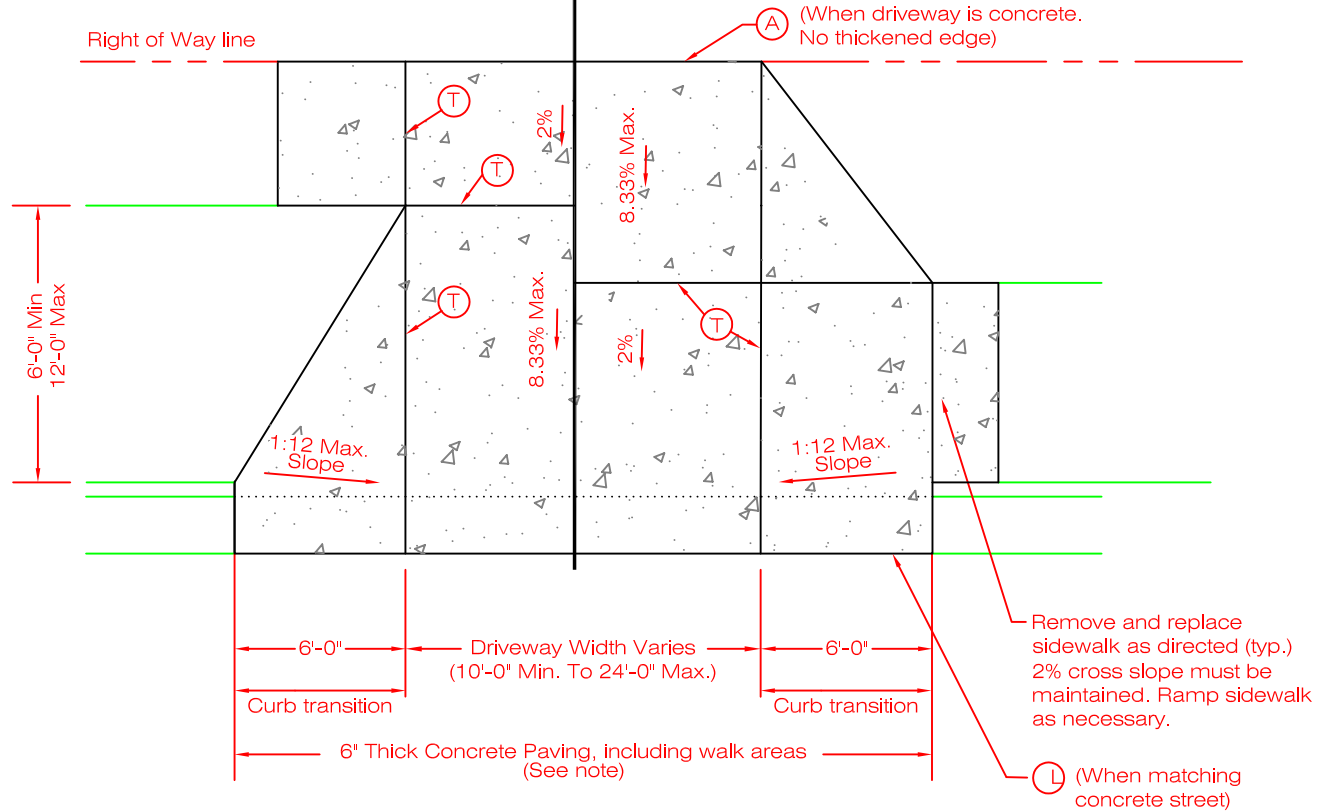

NOTES:

1. For construction in existing asphalt streets, refer to Detail 12.0 for asphalt patch requirements.
2. For (A), (L) and (T) joints, refer to Detail 11.2.
3. Tooled contraction joints are required to control the location of cracking and to provide definition of sidewalk and driving surfaces. Tooled joints for driveway approaches shall be located as indicated above. Additional longitudinal tooled joints may be required when the driveway width exceeds 15'.
4. Tree grate cannot be used as part of the sidewalk.

DATE: 5/05

CITY & COUNTY OF DENVER  
STANDARD RESIDENTIAL DRIVEWAY



STD. DWG NO.

6.0