


Storm Drainage and Sanitary Sewer Construction Detail and Technical Specifications Alley Patching (Resurfacing) Specs.

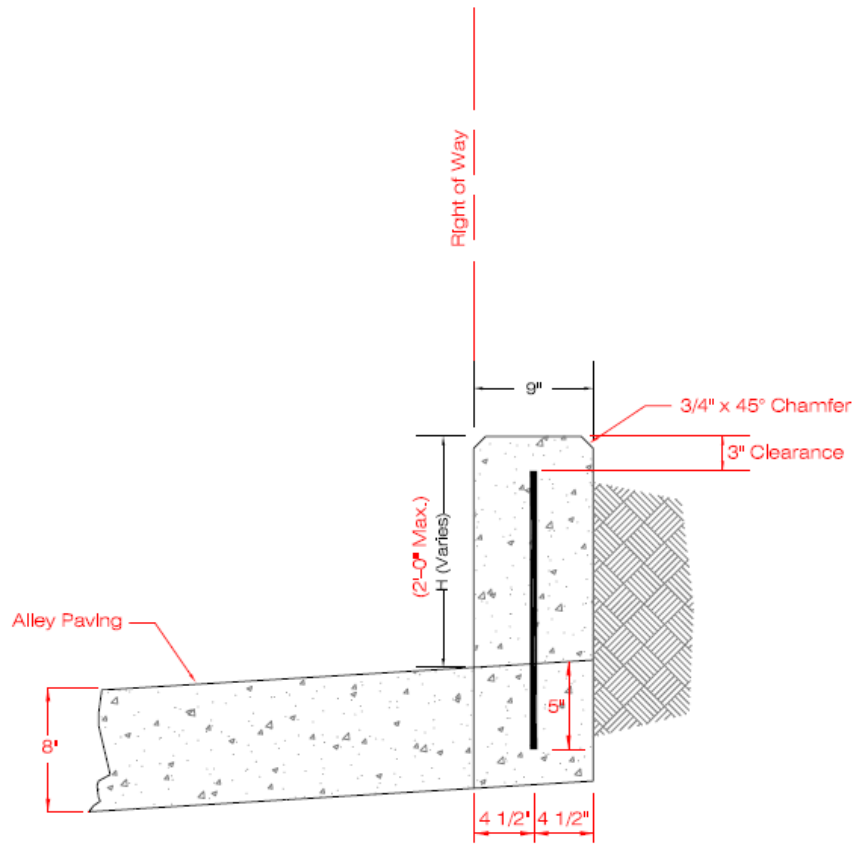

NOTES:

1. Curb Head Is to be poured separately from alley at locations as determined by the Engineer.
2. Place No. 4 Deformed Bars @ 12" on center as directed by the Engineer.
3. If the curb height Is 6' or under, no rebar Is required.
4. For $H > 2'-0"$, a retaining wall design Is required.
5. Jointing should be consistent with alley pavement joints.

DATE: 05/05

CITY & COUNTY OF DENVER

PUBLIC
WORKS

STD. DWG NO.

ALLEY CURB HEAD



10.4

Minor Projects 10.4



PWWMD_SD&SSC
DTsMPgraphic10.4
Revised: April 16, 2008